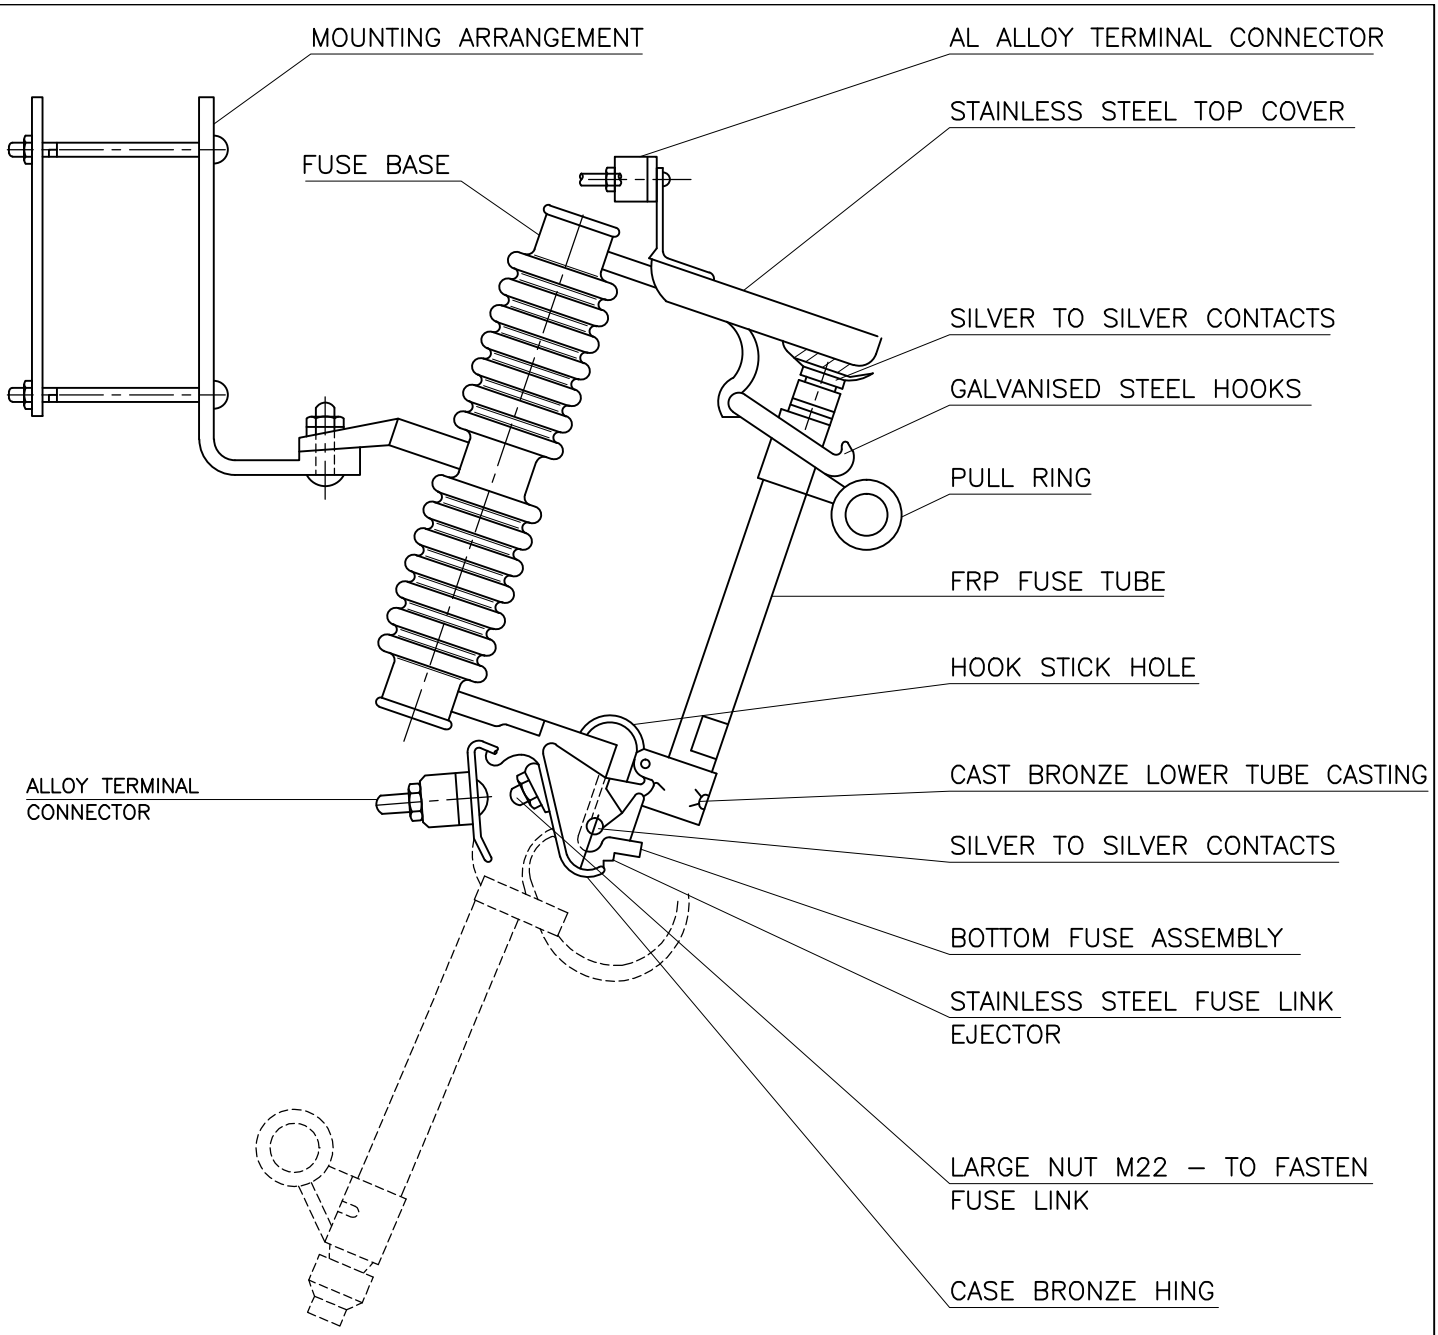

NOTES:–

1. FOR SOLID CORE INSULATOR REFER DRAWING NO:–BESCOM/GM/QS&S/29

	Signatures	All dimensions are in mm unless otherwise stated.	BESCOM
Chd	AGM (QS&S)	11 KV FUSE CUT OUT (D.O.LO)	Approved: General Manager,(Elec.) QS&S
Sub	DGM (QS&S)		DRG.NO.BESCOM/GM/QS&S/20 REV–002 DATED:24–11–2018
SCALE: N.T.S			